

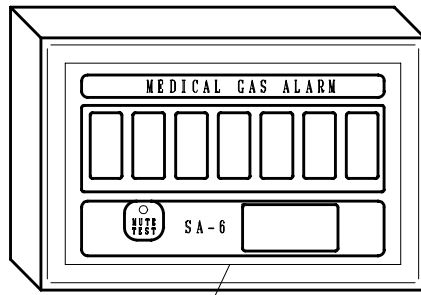


SA-6 AREA ALARM

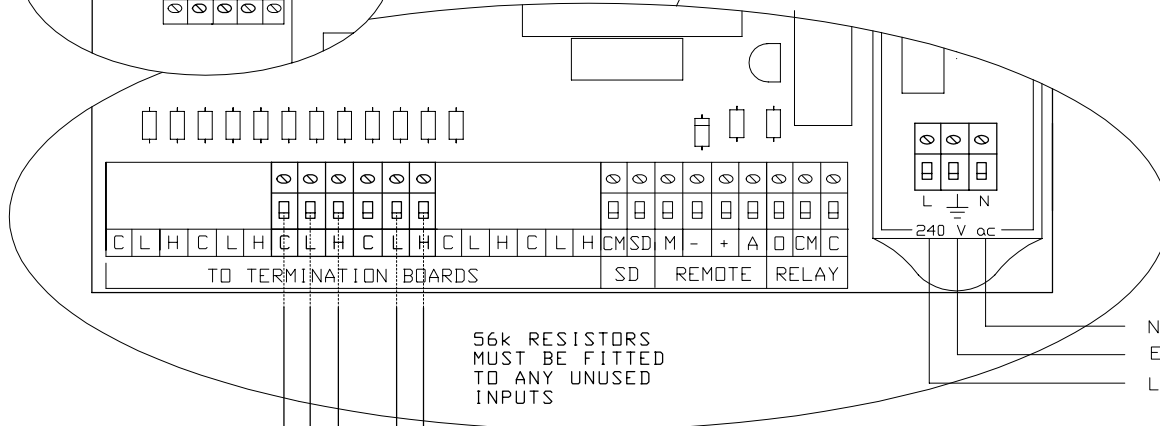


CHECK 'LINK'
'SO' to 'SM'

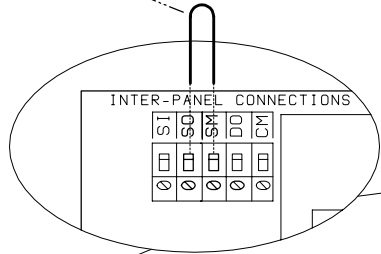

NEUTRAL
EARTH
LIVE

240 Vac SUPPLY
FUSED AT 3 AMPS

NOTE
TERMINATION BOARDS OR
BOXES MUST BE MOUNTED
AS CLOSE AS POSSIBLE
TO THE PRESSURE SWITCHES

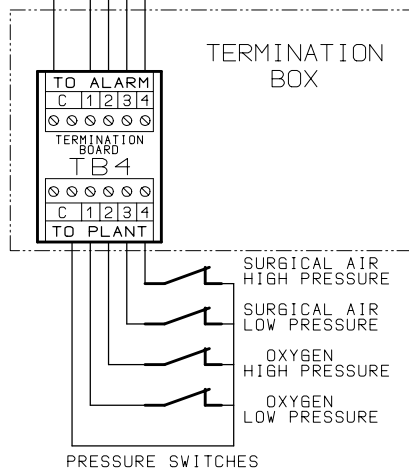

Shire Controls Ltd

Title

SA-6 2 GAS AREA ALARM

Drawing No SA2G

Date 26-02-98

Issue 1

NOTE

ALL SIGNAL CABLE TO BE A MINIMUM OF 0.5 mm sq SCREENED / S.W.A / OR IN METAL CONDUIT. ALL JUNCTION BOXES MUST HAVE THE SCREENS CONNECTED THROUGH