
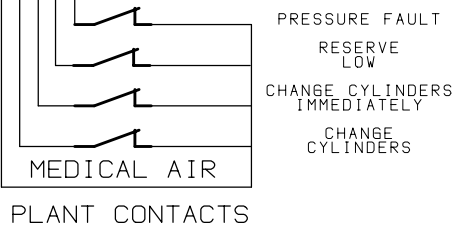
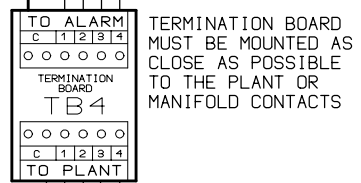
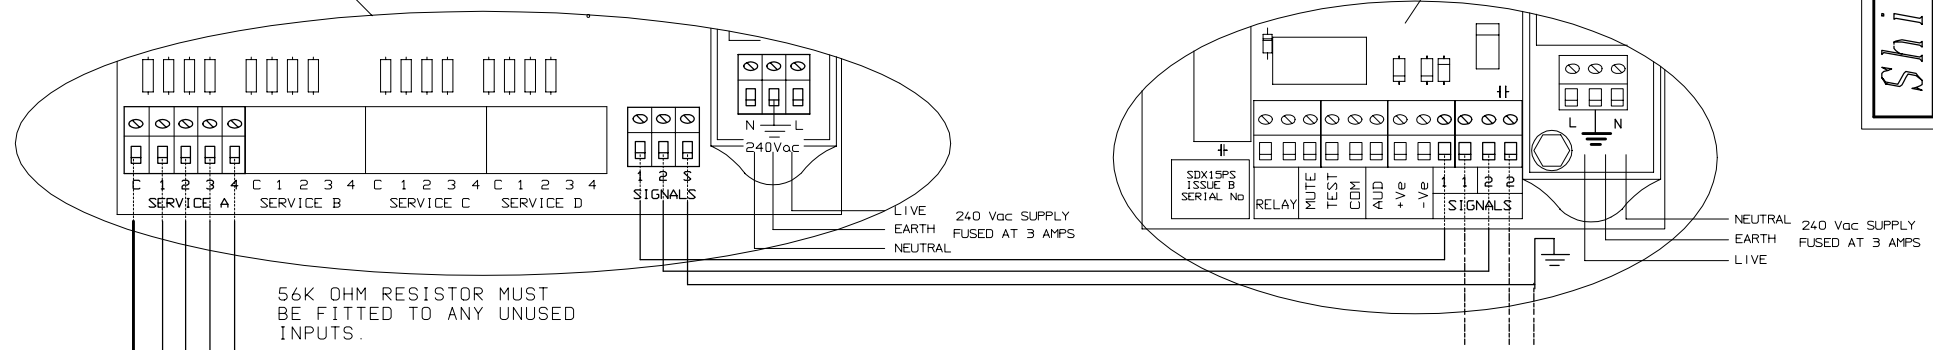


CENTRAL OR REPEATER
ALARM PANELS

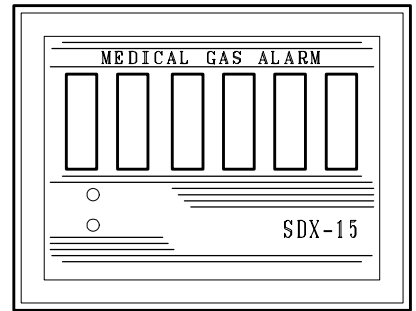

NOTE

ALL SIGNAL CABLE TO BE A MINIMUM OF 0.5 mm sq SCREENED / S.W.A / OR IN METAL CONDUIT.

ALL JUNCTION BOXES MUST HAVE THE SCREENS CONNECTED THROUGH

ALL SCREENS MUST BE EARTHED

Shire Controls Ltd
Title
CONNECTIONS TO A 1 GAS
SDX-15 REMOTE TRANSMITTER
Drawing No SDXRTX1
Date 17-10-2000 Issue 1